


PLAN VIEW

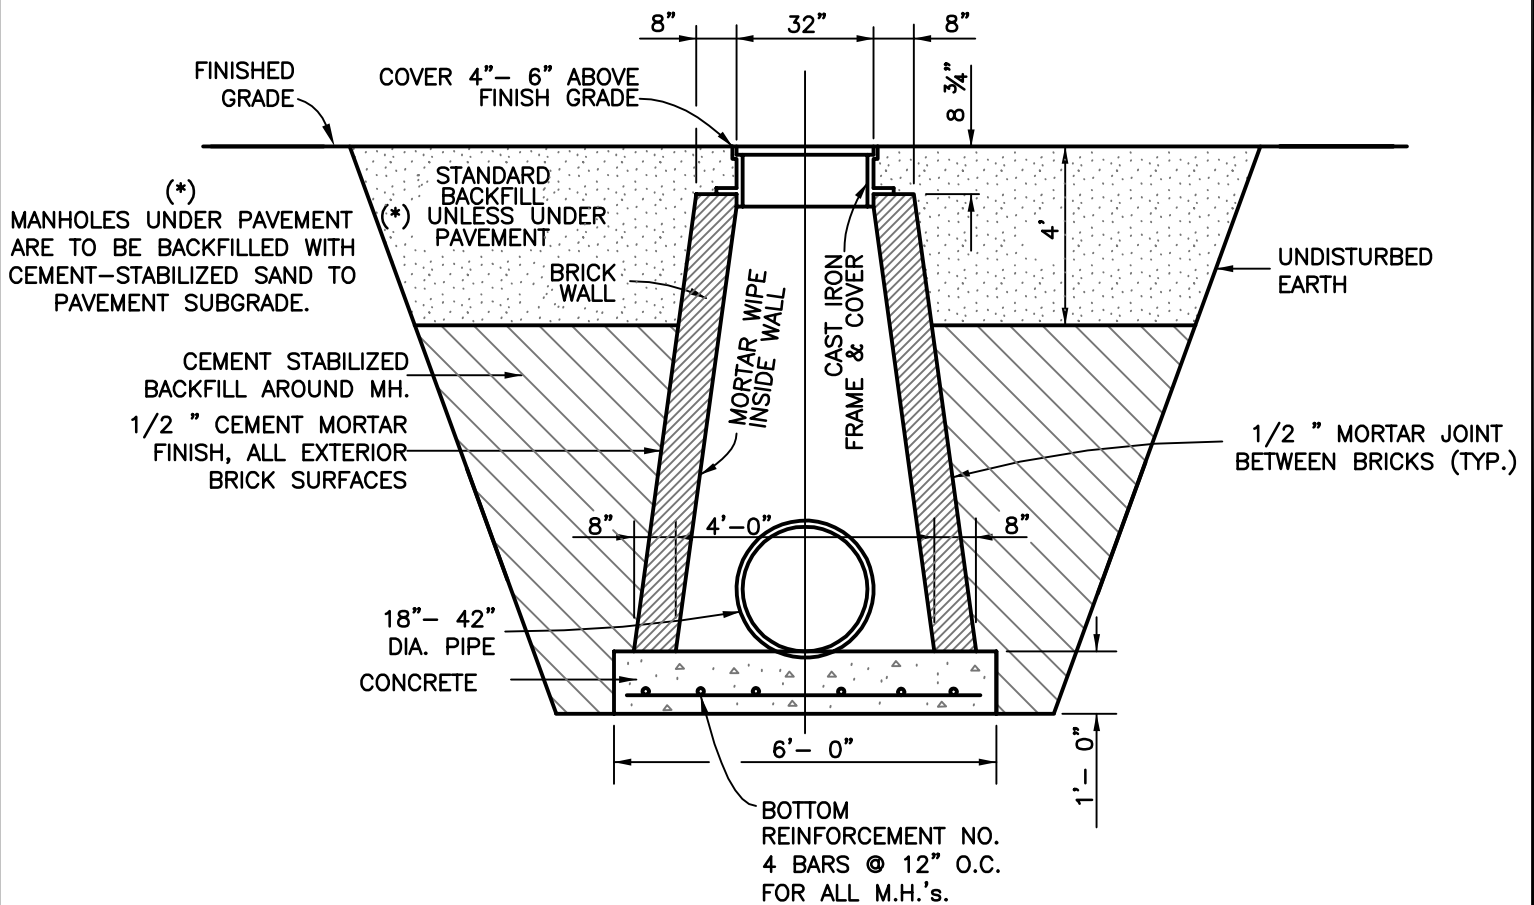

SECTION "A-A"

NOTES:

1. BRICK WALLS 8'-0" BELOW CASTING TO BE 12" THICK.
2. ALL BRICK MATERIAL SHALL CONFORM WITH ASTM C32, GRADE NA, EXCEPT NOT MORE THAN 16% GRADE ABSORPTION WILL BE PERMITT
3. ALL MANHOLE CHIMNEYS SHALL BE BRICK OR THROAT RING.

THE CITY OF ROSENBERG, FORT BEND COUNTY, TEXAS
DEPARTMENT OF PUBLIC WORKS

BRICK
TYPE "C" MANHOLE 18"-42"

| | | | | |
|----------------|---------------|---------------|----------------|-------------------|
| DESIGN: CAK | CAD: STAFF | SCALE: NTS | DATE: 11/10 | DRAWING: D-101 |
|----------------|---------------|---------------|----------------|-------------------|